

Kidde ECS Fire Suppression System Component Description





Cylinder and Valve Assembly, 125 lb. (56.7 kg) Capacity

Effective: August 2015
K-90-2030 Rev BB

FEATURES

- *UL Listed, ULC Listed, and FM Approved for use with Kidde ECS Systems with HFC-227ea Agent*
- *RoHS Compliant*

P/N: 90-10012X-001

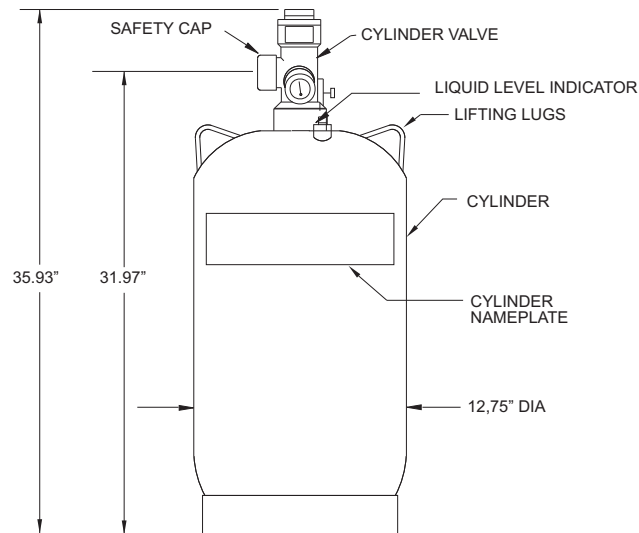

ORDERING INFORMATION

Part Number	Description
90-100121-001	w/LLI
90-100125-001	STD

MATERIALS

- **Valve Body:** Brass
- **Cylinder:** Steel, Painted Red

COMPATIBILITY

Series	For Use With
Kidde ECS HFC-227ea	X

Notes:

1. The safety cap must be installed on the valve outlet at all times, except when the cylinders are connected to the system piping, or being filled. The safety cap must not be removed from its chain.
2. See K-90-2020 for additional information.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL Inc.

Kidde is a registered trademark of Kidde-Fenwal Inc. All other trademarks are the property of their respective owners.